


GROUT (NON-SHRINK) THE FOLLOWING:

1. SEAMS, INSIDE AND OUTSIDE
2. LIFTING HOLES, INSIDE AND OUTSIDE.
3. OUTSIDE GROUTED SEAMS AND LIFTING HOLES TO BE COVERED WITH BITUMINOUS COATING.

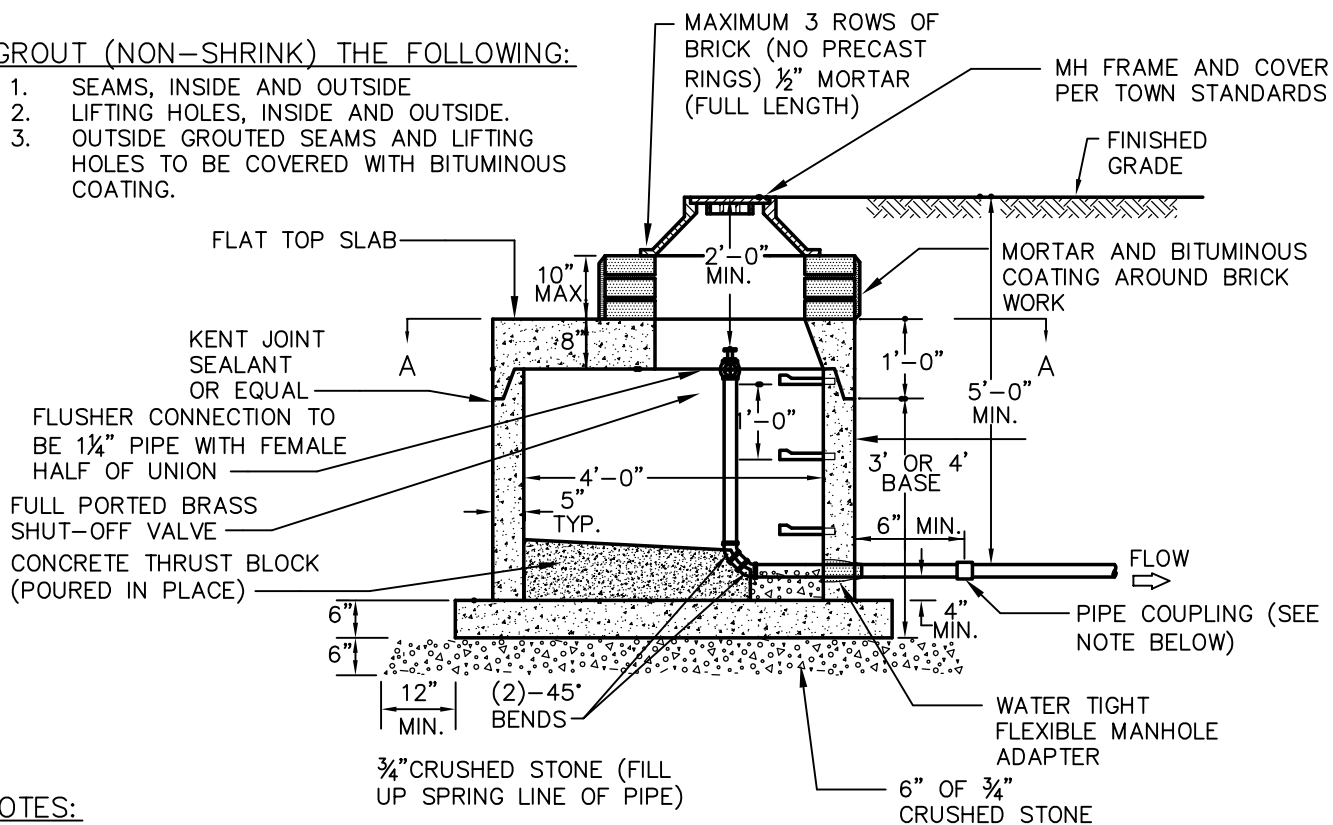

NOTES:

1. BOTTOM STEP TO BE A MAXIMUM OF 1'-4" FROM FLOOR OF MANHOLE.
2. CONCRETE BRICK AND/OR PORTLAND CEMENT MORTAR TO BE USED UNDER FRAME.
3. PIPE AND FITTING SHALL HAVE PRESSURE RATING OF NO LESS THAN 300 P.S.I.
4. PIPE COUPLINGS SHALL BE CAST DUCTILE IRON JCM MODEL 211, ROMAC MODEL 501 OR 511, FORD MODEL FC1 OR APPROVED EQUAL.
5. ALL PIPE AND FITTINGS WITHIN MANHOLE STRUCTURE TO BE BRASS.

SEE THE TOWN OF GLASTONBURY SPECIFICATIONS FOR ADDITIONAL INSTALLATION INFORMATION.



SCALE : NONE
DRAWN BY: SR
CHECKED BY: SMB
APPROVED BY: DAP
LAST REVISED:
4/29/2008



TOWN OF GLASTONBURY
DEPARTMENT OF PHYSICAL SERVICES
ENGINEERING DIVISION

DEAD END MANHOLE
FOR FORCED SEWER MAINS

PLATE NO. 41